




VIEW ON HV SIDE
PHASE ROTATION
1U 1V 1W

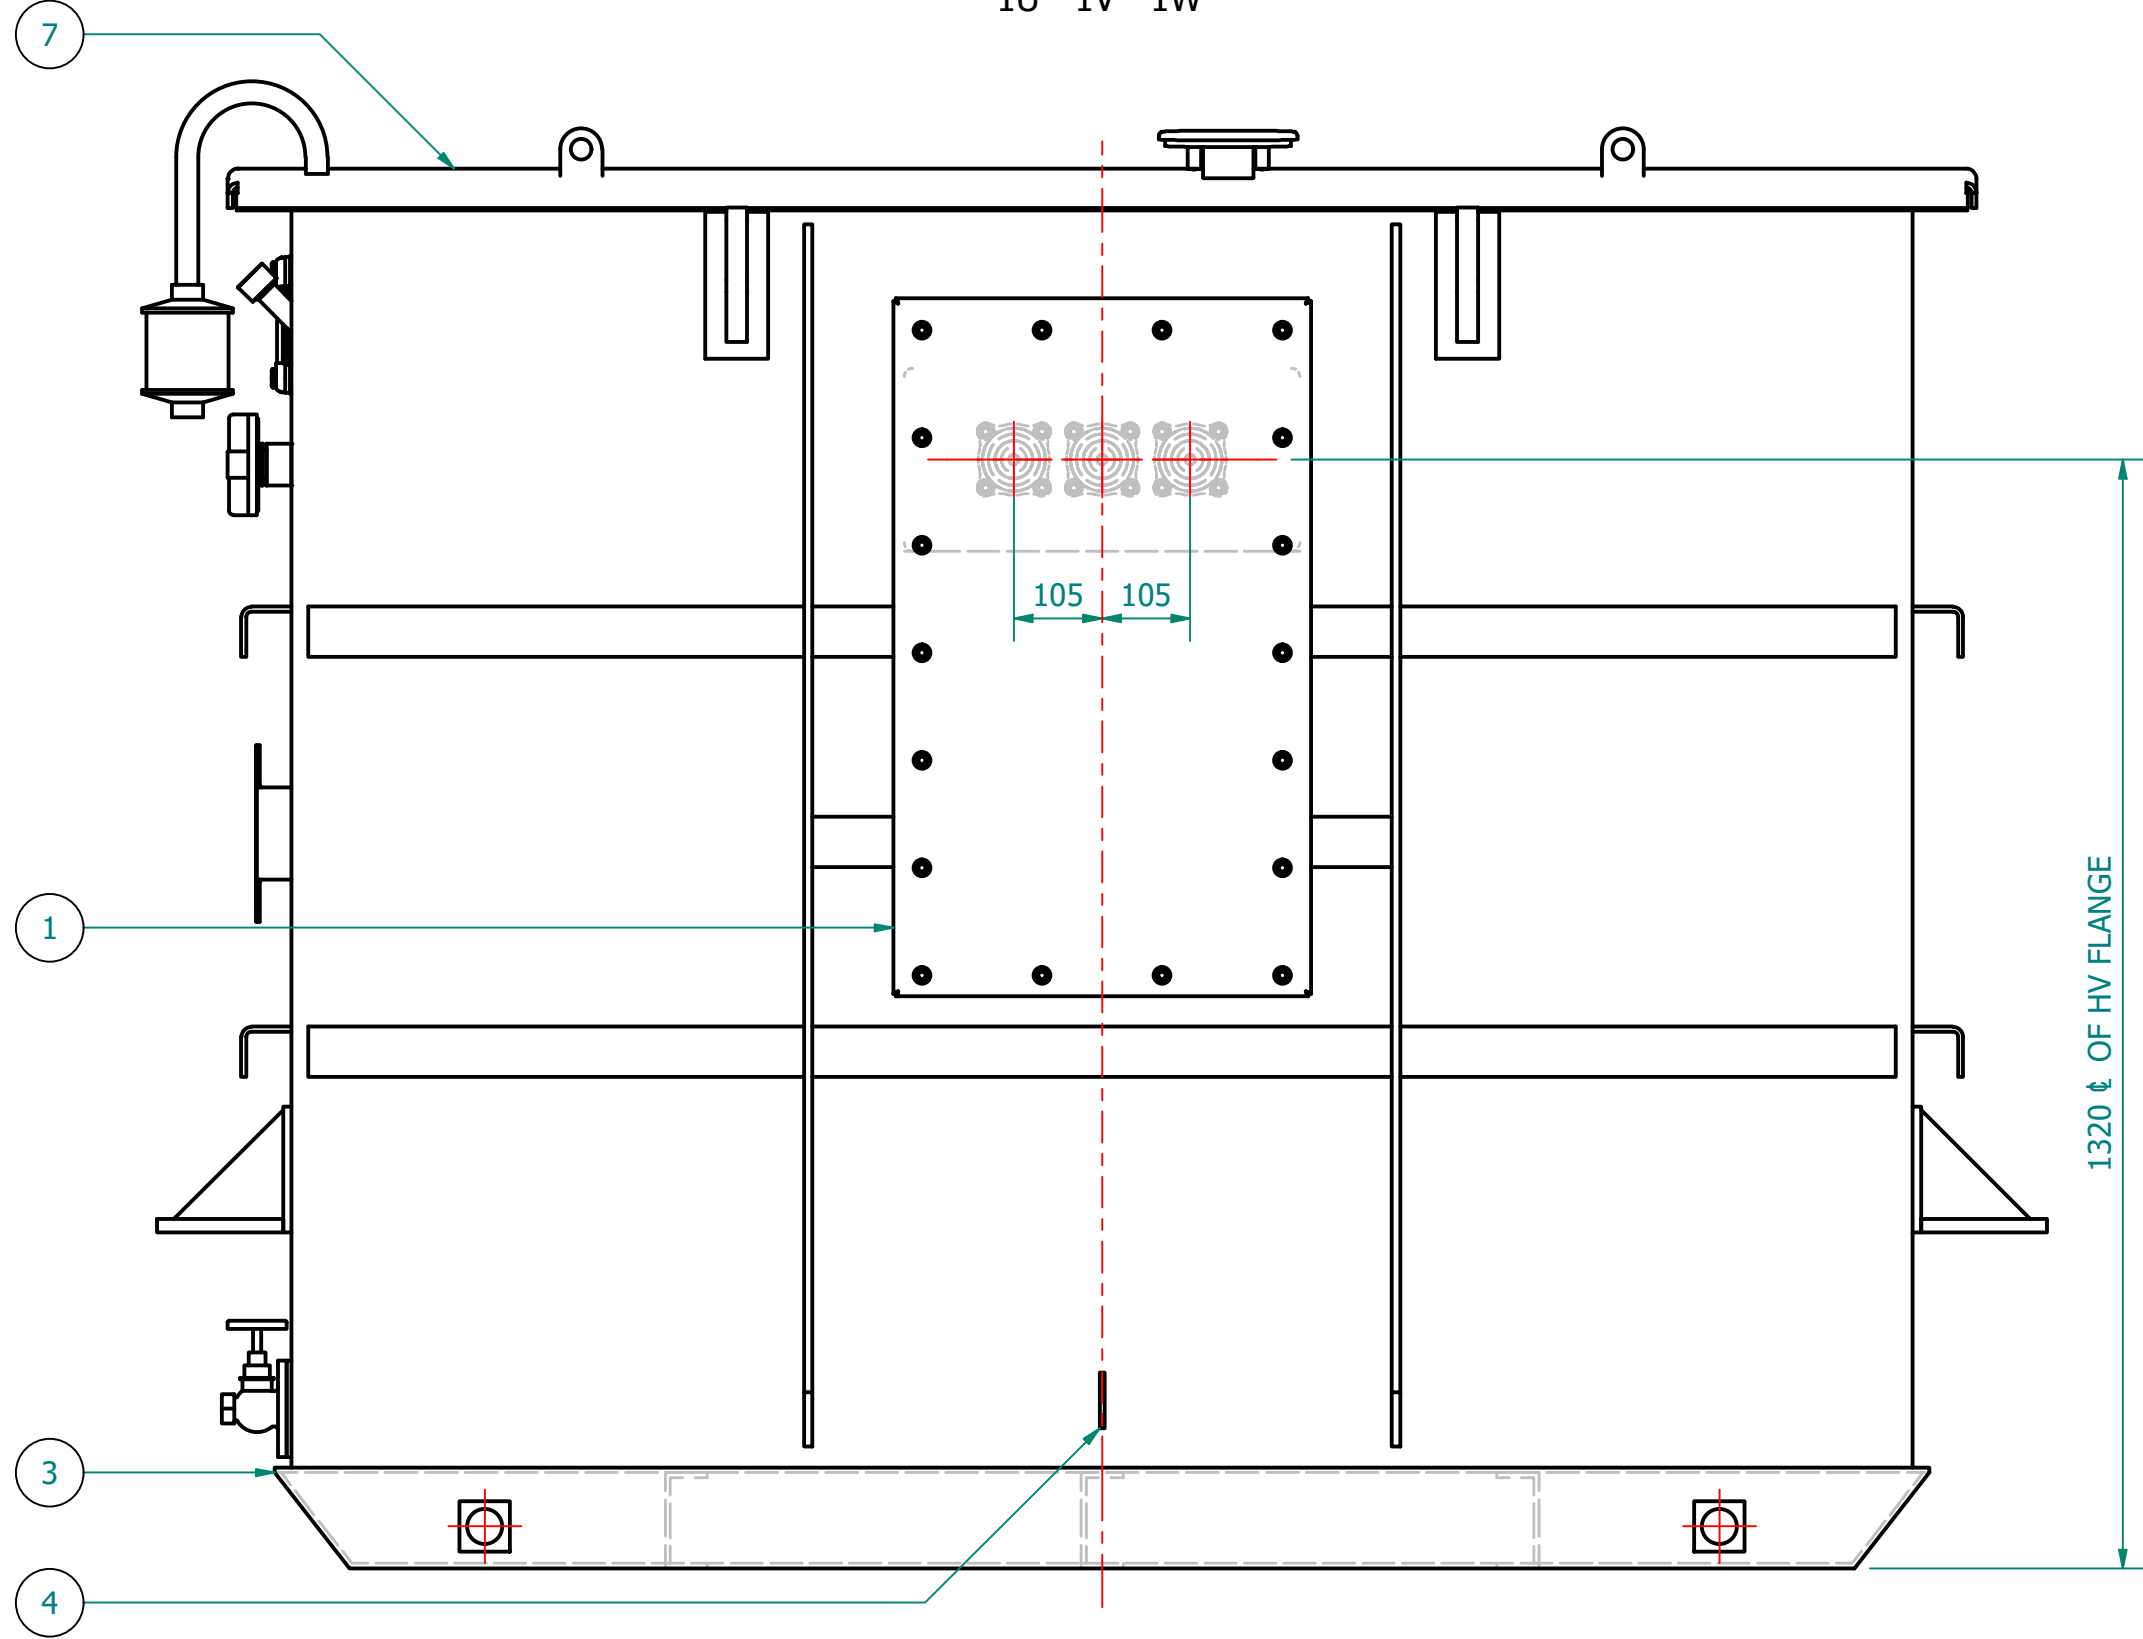


VIEW ON TAP SWITCH END

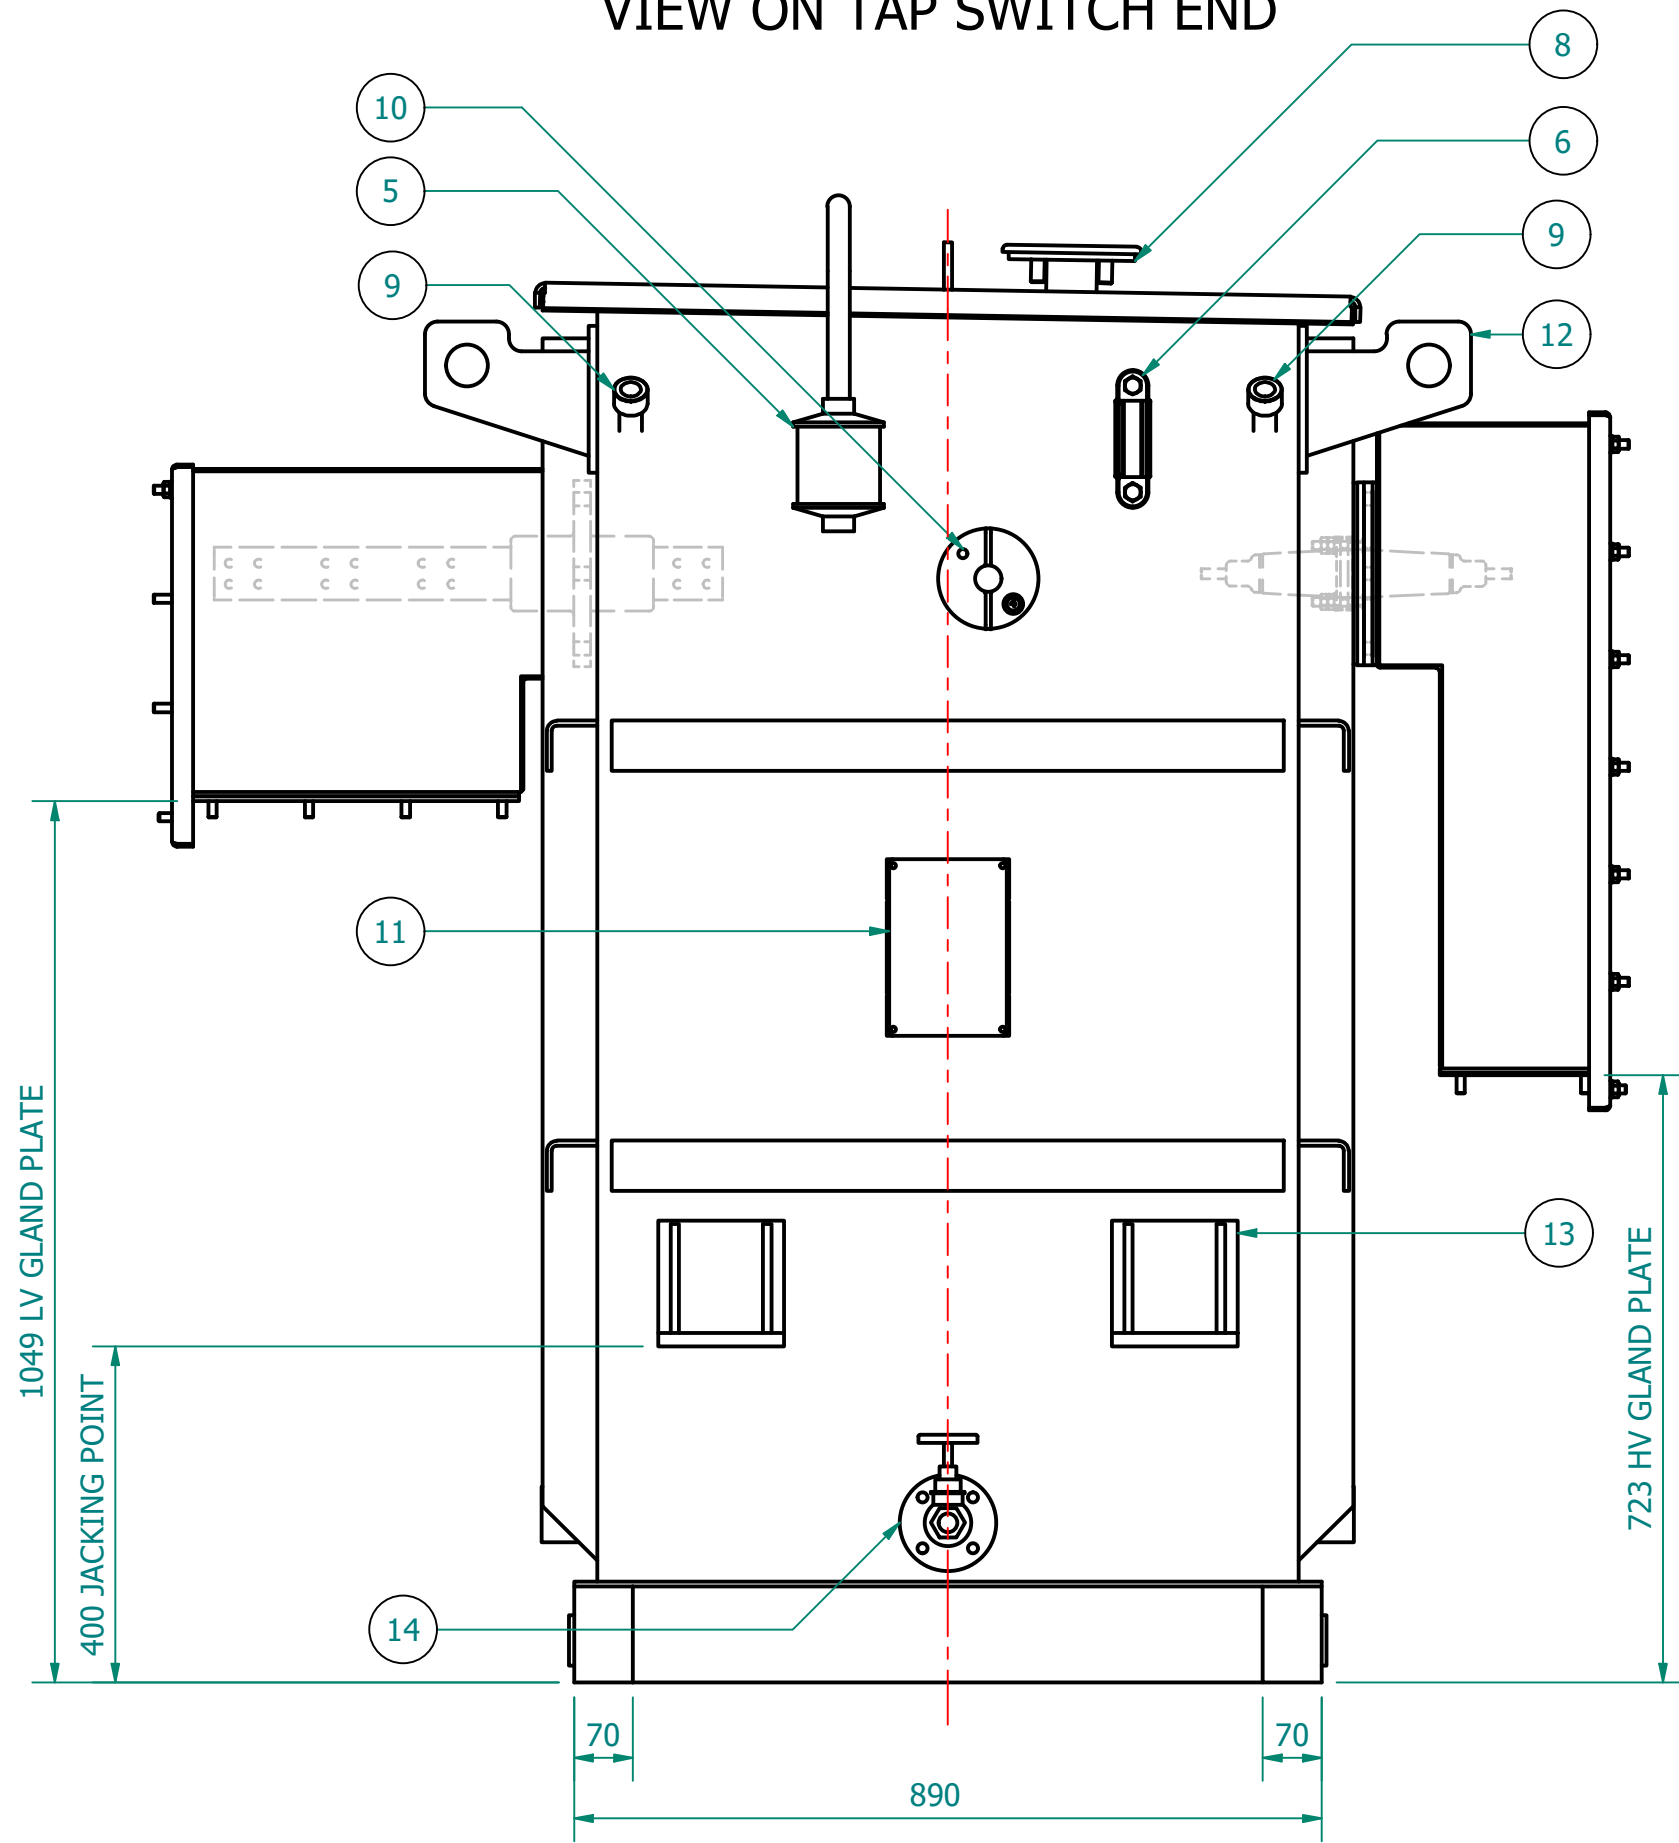

VIEW ON LV SIDE
PHASE ROTATION
2W 2V 2U 2N

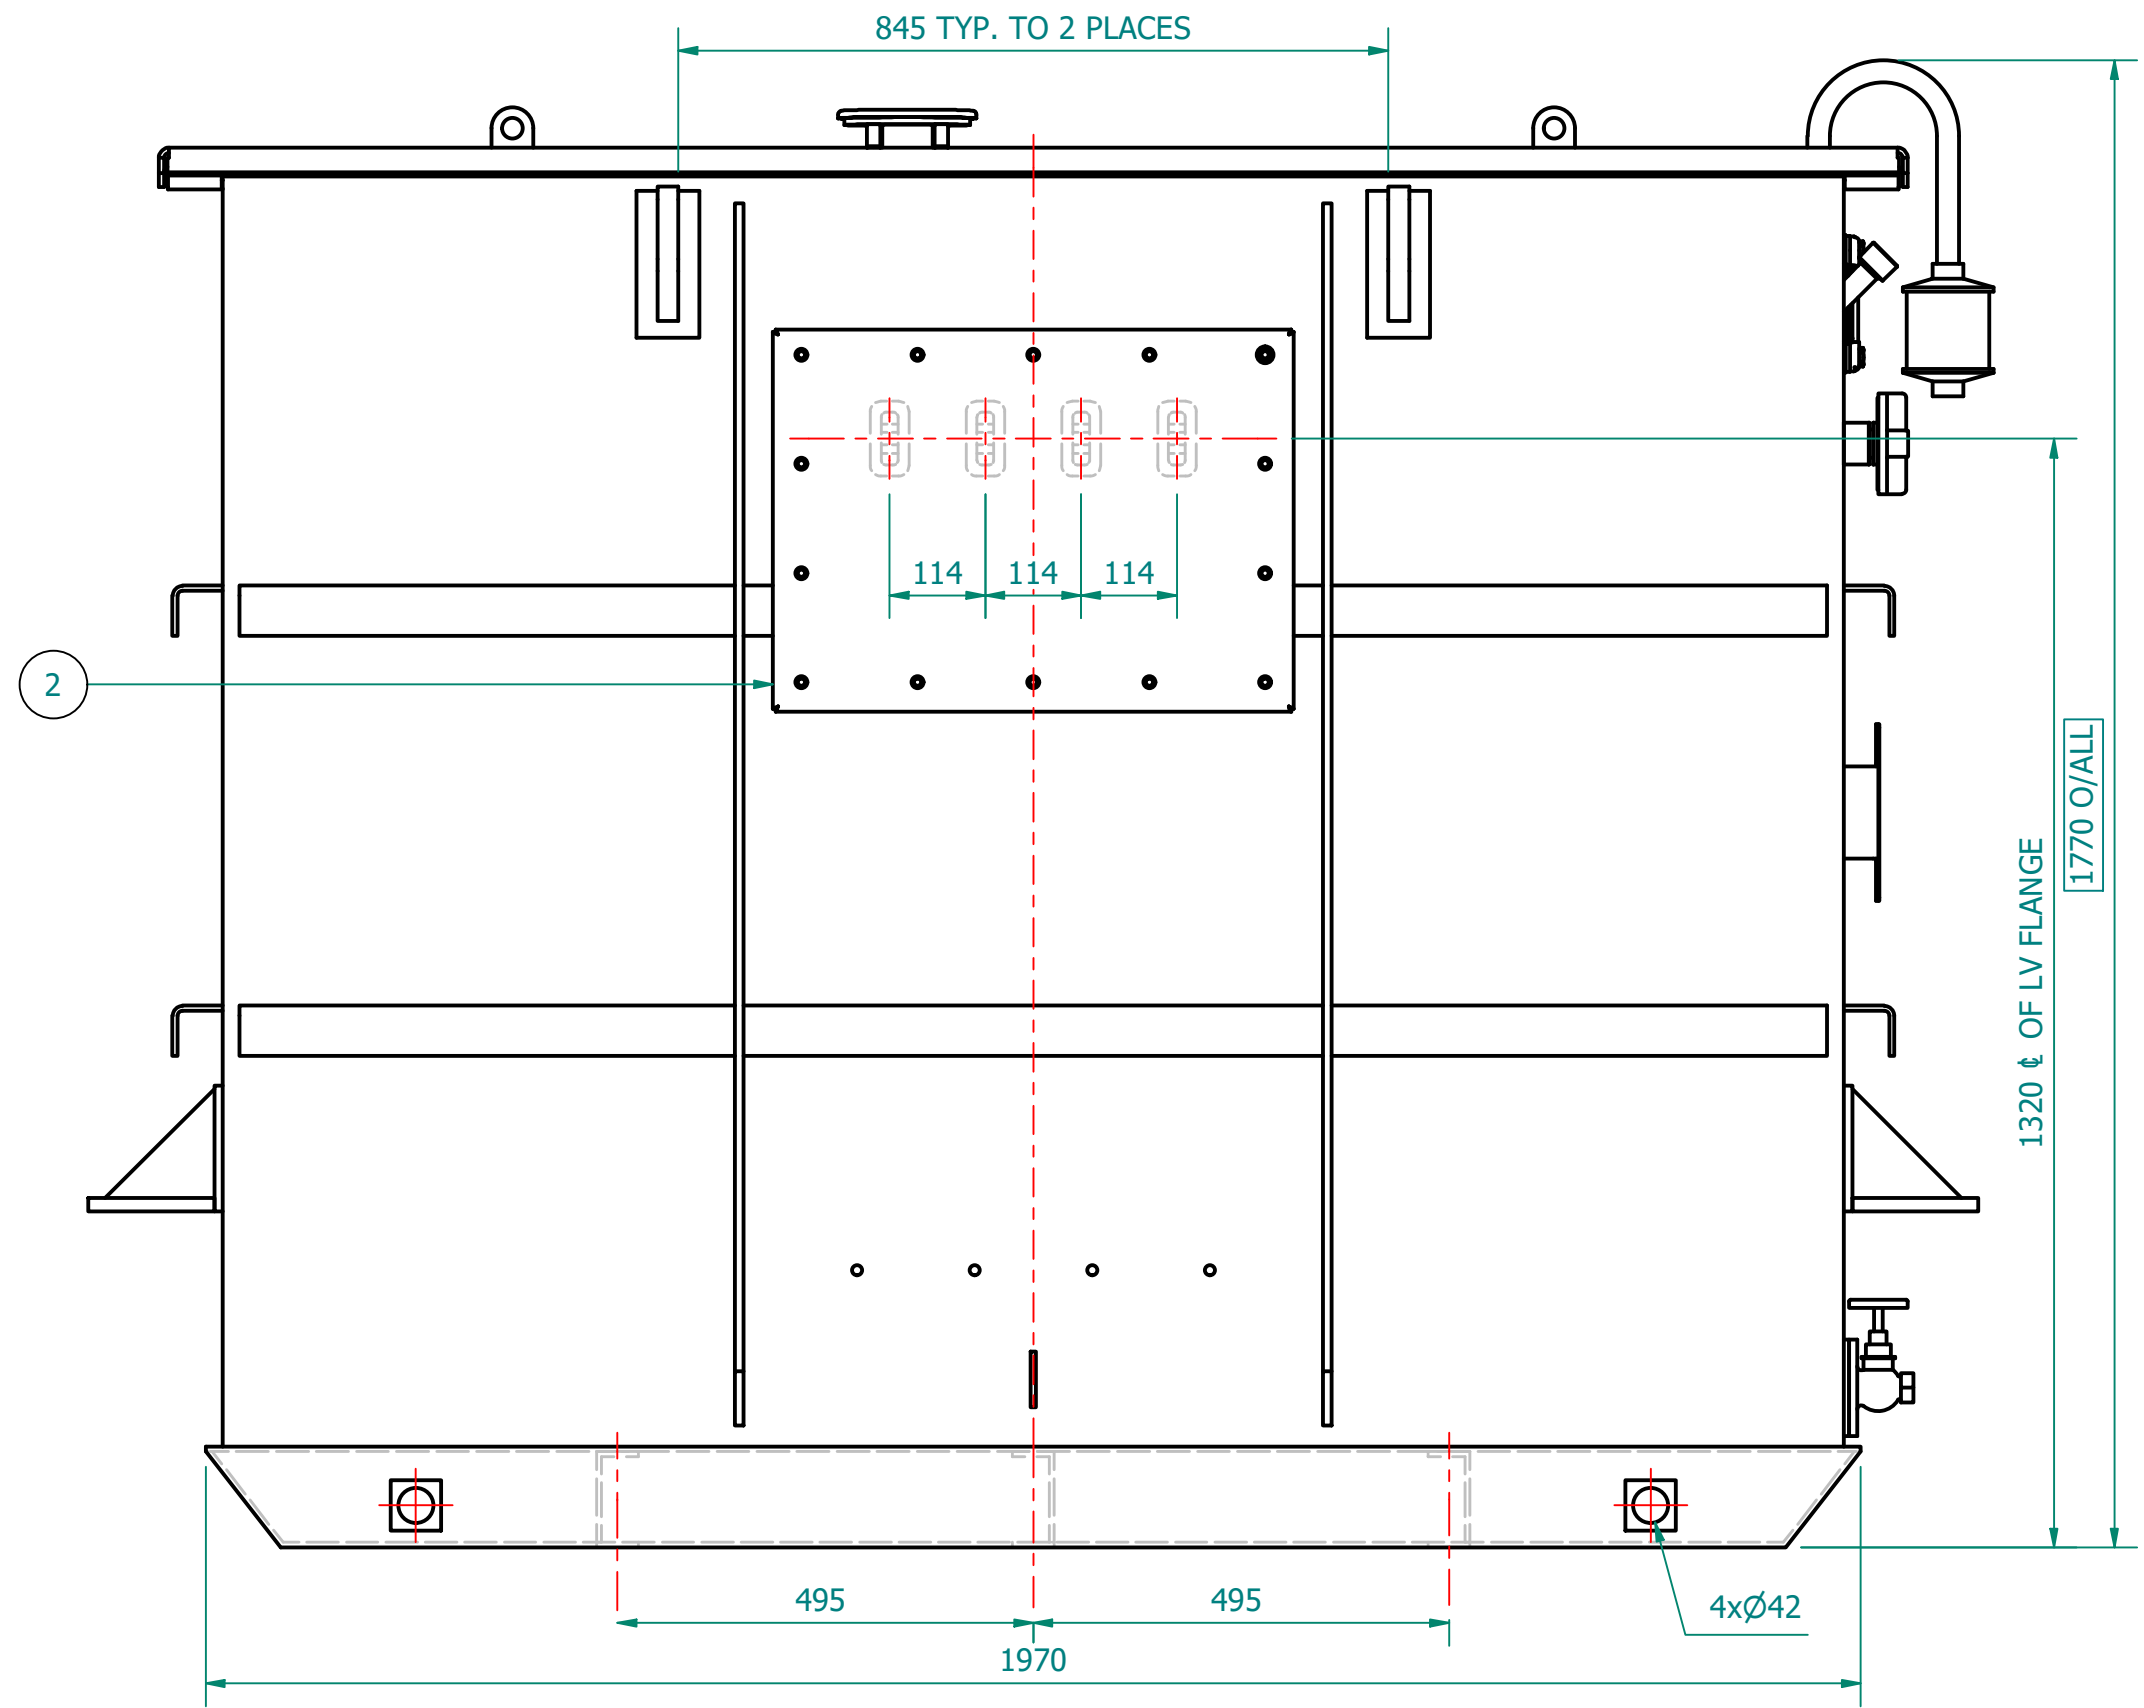


PLAN VIEW

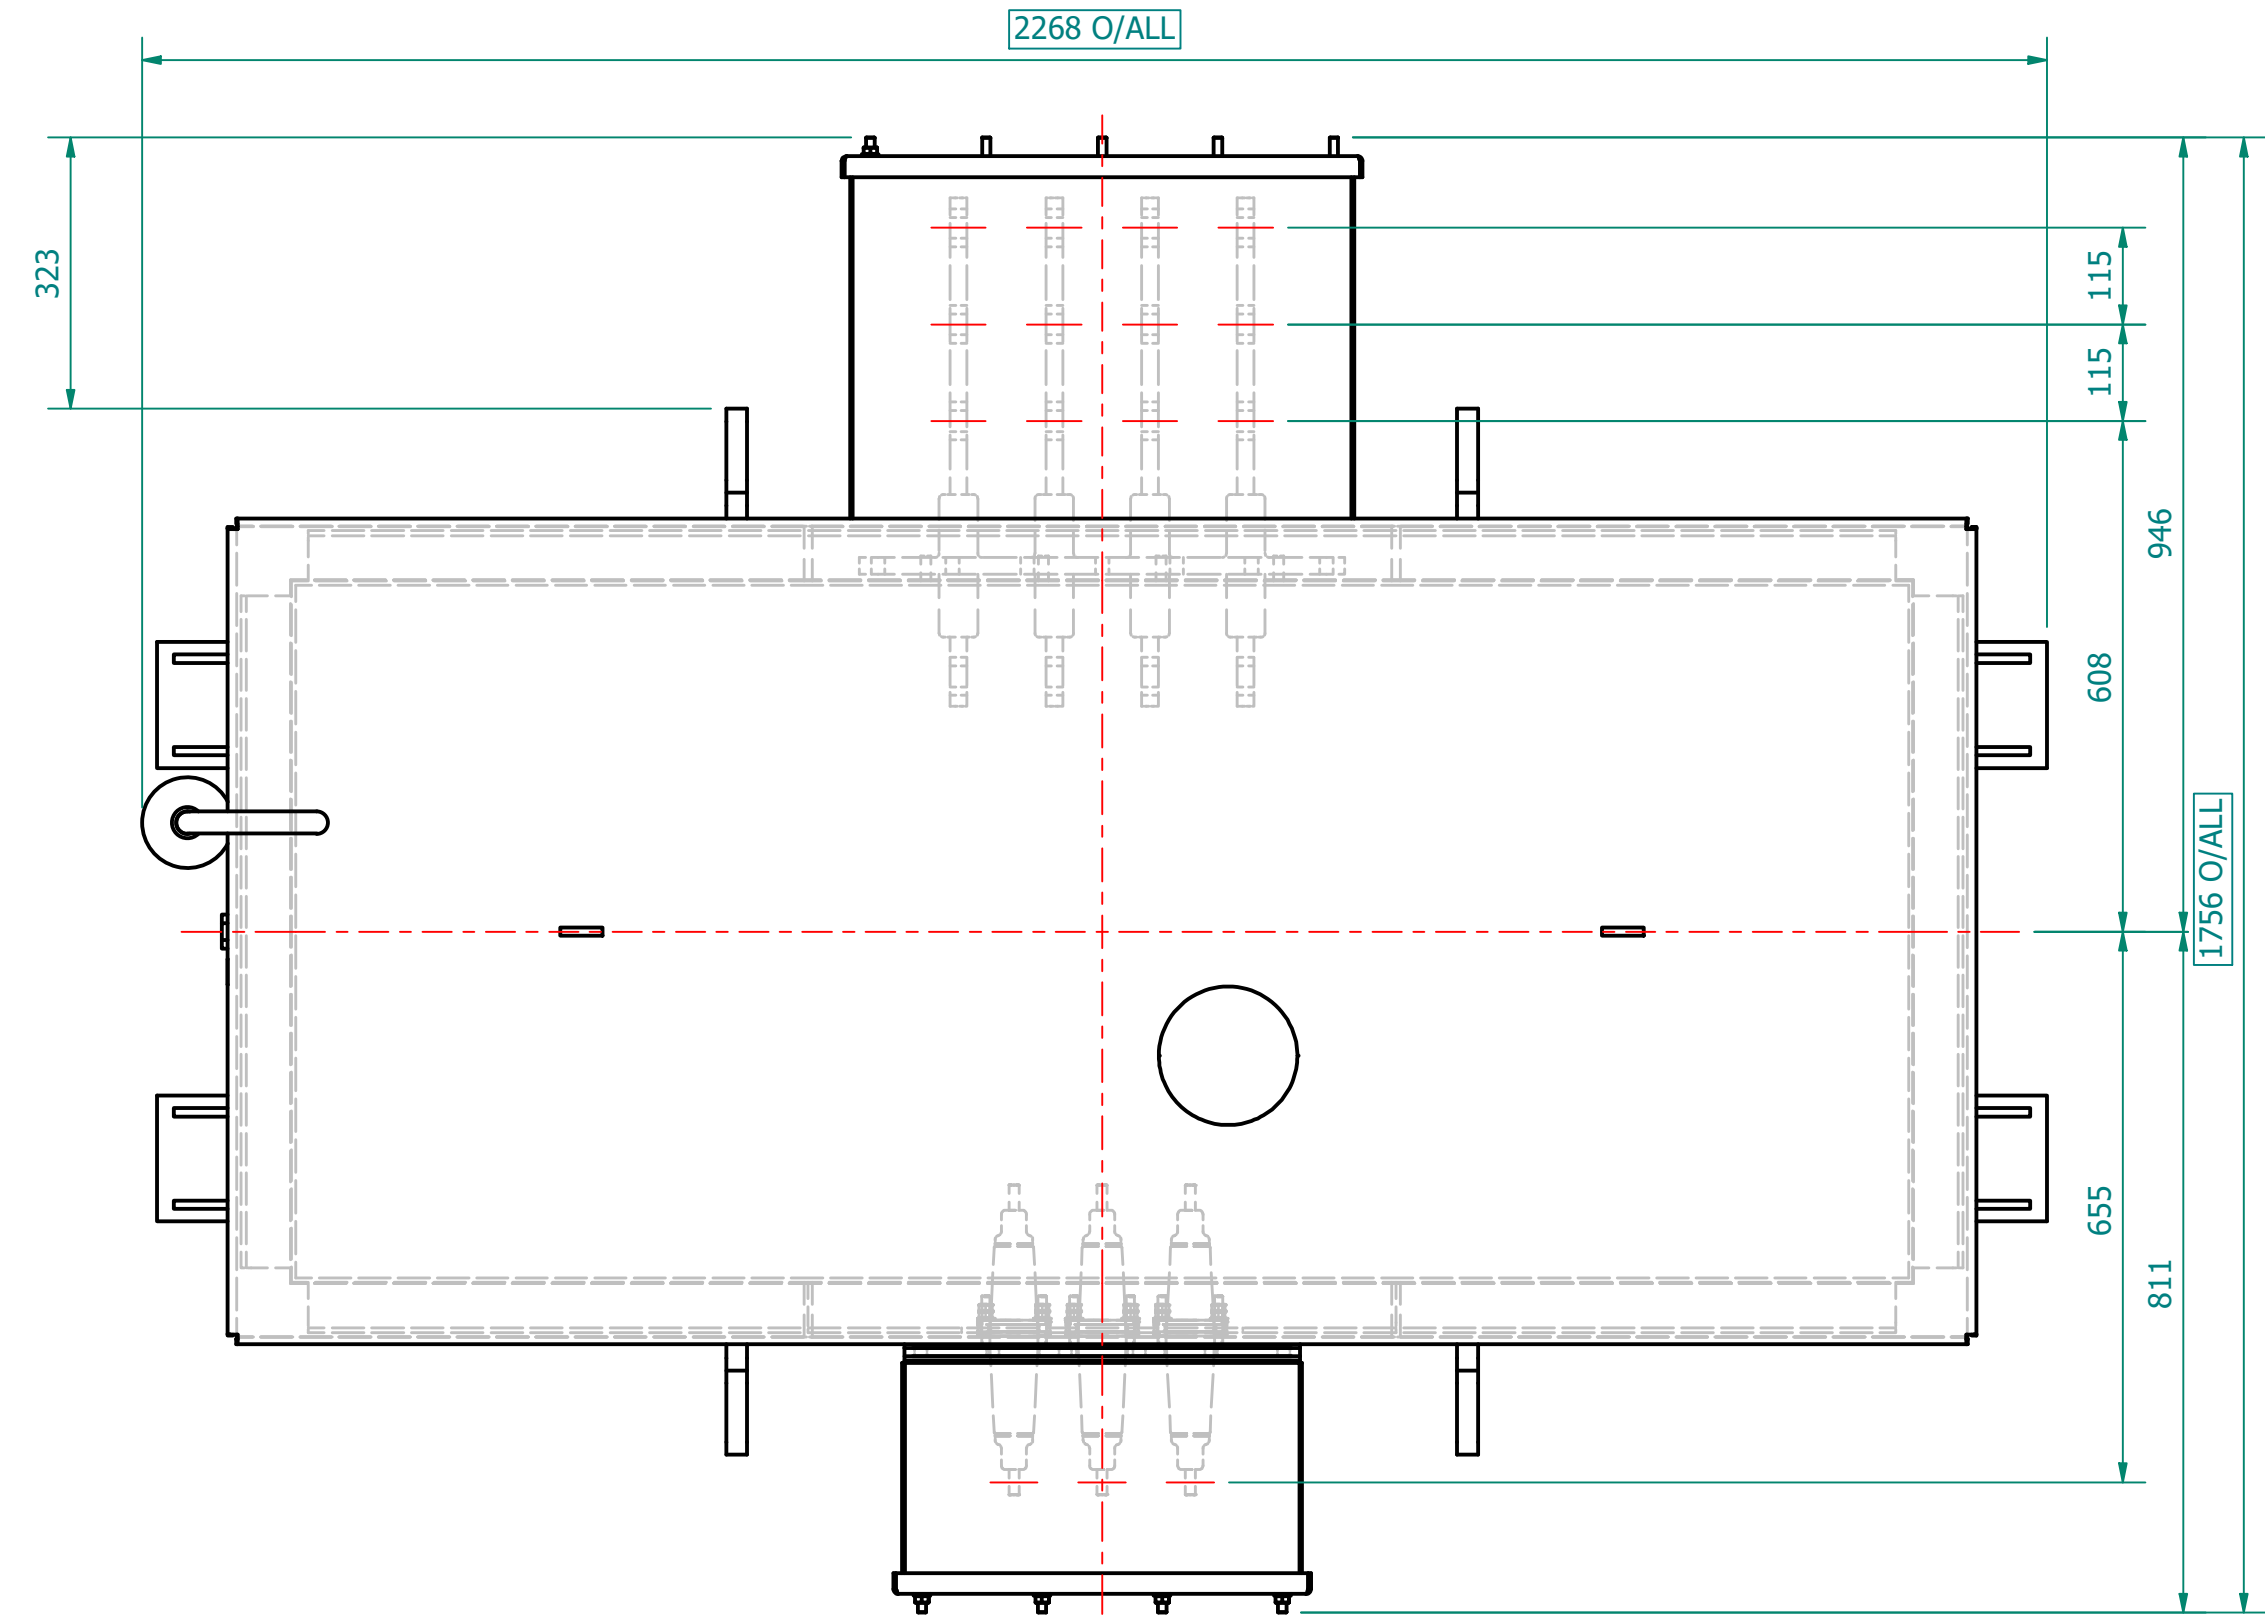


TRANSFORMER WEIGHT & VOLUME		
CORE AND WINDING	kg	3400
TANK AND FITTING	kg	850
COOLING LIQUID VOLUME	L	1474
COOLING LIQUID WEIGHT	kg	1430
TOTAL TX WEIGHT	kg	5680

VIEW OF LV SIDE - CABLE CLEAT STUDS
CABLES MUST BE SUPPORTED IN ACCORDANCE WITH -
CURRENT IET Wiring Regulations BS7671 & IEC 61914

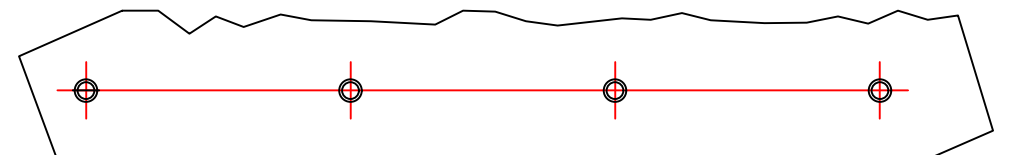

ESSENTIAL LABELS

- ITEM 10 TAP CHANGER WARNING LABEL
- ITEM 6 COLD COOLANT LEVEL
- ITEM 2 LV WARNING LABEL
- ITEM 1 HV WARNING LABEL

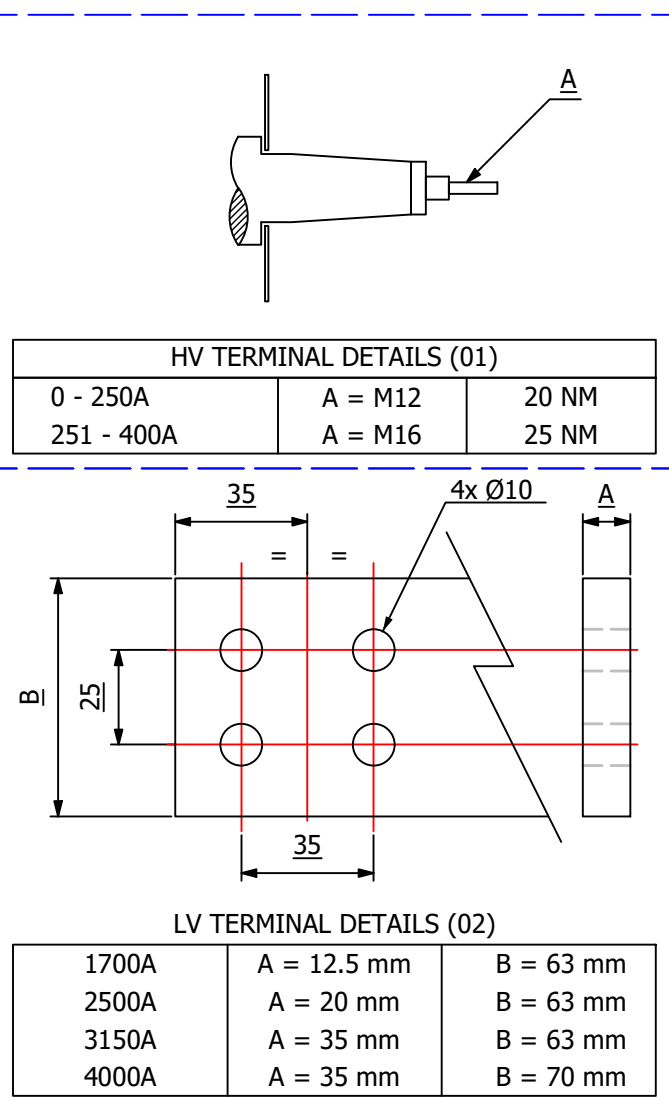

1250kVA ELECTRICAL RATINGS					
No Load Voltage Ratio at Normal Tap	HV Tappings	Vector Group	Frequency	Full-Load Current at Normal Tap	
				HV Side	LV Side
11000 / 415V	+7.5 to -5.0% IN 2.5% INCREMENTS	Dyn11	50Hz	65.608A	1739.007A
Design Impedance at Normal Tap	No Load Losses at rated Voltage & Frequency	Full Load Losses at rated Current & at 75°C Temp.	Temp. Rise above Ambient 40°C		
			in Oil by Therm.		in Wdg. by Res.
5.0%	570W	6930W	60°C	65°C	
GENERAL NOTES					
1 ALL DIMENSIONS ARE IN 'mm'.					
2 ALL DIMENSIONS/WEIGHTS ARE SUBJECT TO ± 10% TOLERANCE.					
3 ELECTRONIC SCALE - 1:1 (ONLY WRITTEN DIMENSIONS TO BE FOLLOWED).					
4 TOLERANCE ON IMPEDANCE PER IEC:60076.					
5 PAINT SHADE.: 632 As PER BS:381C (SEMI GLOSS) TO ISO12944 - MIN C4H SPEC.					
6					
7					
8					
9					

ITEM	QTY	DESCRIPTION
14	1	DRAIN VALVE (25NB) with MALE PLUG
13	4	JACKING PADS
12	4	TRANSFORMER LIFTING LUGS
11	1	RATING & DIAGRAM PLATE (SS)
10	1	OFF-CIRCUIT TAP SWITCH (6-Position & Padlockable)
9	2	THERMOMETER POCKET (3/4" BSP MALE THREAD)
8	1	OIL FILLING PIPE WITH FLANGED COVER
7	1	TOP COVER with LIFTING LUGS (x2)
6	1	OIL LEVEL GAUGE (with 15°) COLD OIL LEVEL MARK
5	1	ENVIRO GEL BREATHER TYPE R
4	2	EARTHING TERMINAL (FLAT TYPE suitable for M12 Bolt)
3	1	TRANSFORMER BASE (SKID TYPE) c/w HAULAGE HOLES & BRACING
2	1	LV CABLE BOX - 1.1kV, 4-POLE, AIR INSULATION, (FACING-'F', BS:2562) SUITABLE FOR 3 x 1c CABLES PER PHASE & N - MAX. 630mm.sq
1	1	HV CABLE BOX - 12kV, 3-POLE, HEAT-SHRINK INSULATION, (FACING-'E' BS:2562) SUITABLE FOR 1 x 3c CABLE - MAX. 185mm.sq

IF IN DOUBT - ASK. REMOVE ALL SHARP EDGES. DO NOT SCALE. DRAWING NOT TO SCALE

REVISION HISTORY				REVISION DESCRIPTION				PROJECT				DRAWING TITLE				DRAWN BY:			
REV	REV BY	VERIFIED	APPROVED	DESCRIPTION	REV	DATE	00	CUSTOMER		S.O. NUMBER		GENERAL ARRANGEMENT DRAWING FOR 1250kVA WILSON e4 AMORPHOUS ULTIMATE LOW LOSS 11000/415V, 50Hz, Dyn11, KNAN AL WOUND DISTRIBUTION TRANSFORMER		SATHWIK		DATE:	24-03-2026	WPS-E4-1250-AL-GA-KNAN	Westland Square, Leeds, West Yorkshire LS11 5SS, United Kingdom Tel:+44 (0) 113 271 7588 Fax:+44 (0) 113 277 5124 web: www.wilsonpowersolutions.co.uk email: info@wilsonpowersolutions.co.uk
REV	REV BY	VERIFIED	APPROVED	DESCRIPTION	REV	DATE	00	S.O. NUMBER		P.O. NUMBER		AL WOUND DISTRIBUTION TRANSFORMER		DATE:	24-03-2026	WPS-E4-1250-AL-GA-KNAN	24-03-2026	WPS-E4-1250-AL-GA-KNAN	Westland Square, Leeds, West Yorkshire LS11 5SS, United Kingdom Tel:+44 (0) 113 271 7588 Fax:+44 (0) 113 277 5124 web: www.wilsonpowersolutions.co.uk email: info@wilsonpowersolutions.co.uk
REV	REV BY	VERIFIED	APPROVED	DESCRIPTION	REV	DATE	00	W.O. NUMBER						DATE:	24-03-2026	WPS-E4-1250-AL-GA-KNAN	24-03-2026	WPS-E4-1250-AL-GA-KNAN	Westland Square, Leeds, West Yorkshire LS11 5SS, United Kingdom Tel:+44 (0) 113 271 7588 Fax:+44 (0) 113 277 5124 web: www.wilsonpowersolutions.co.uk email: info@wilsonpowersolutions.co.uk