

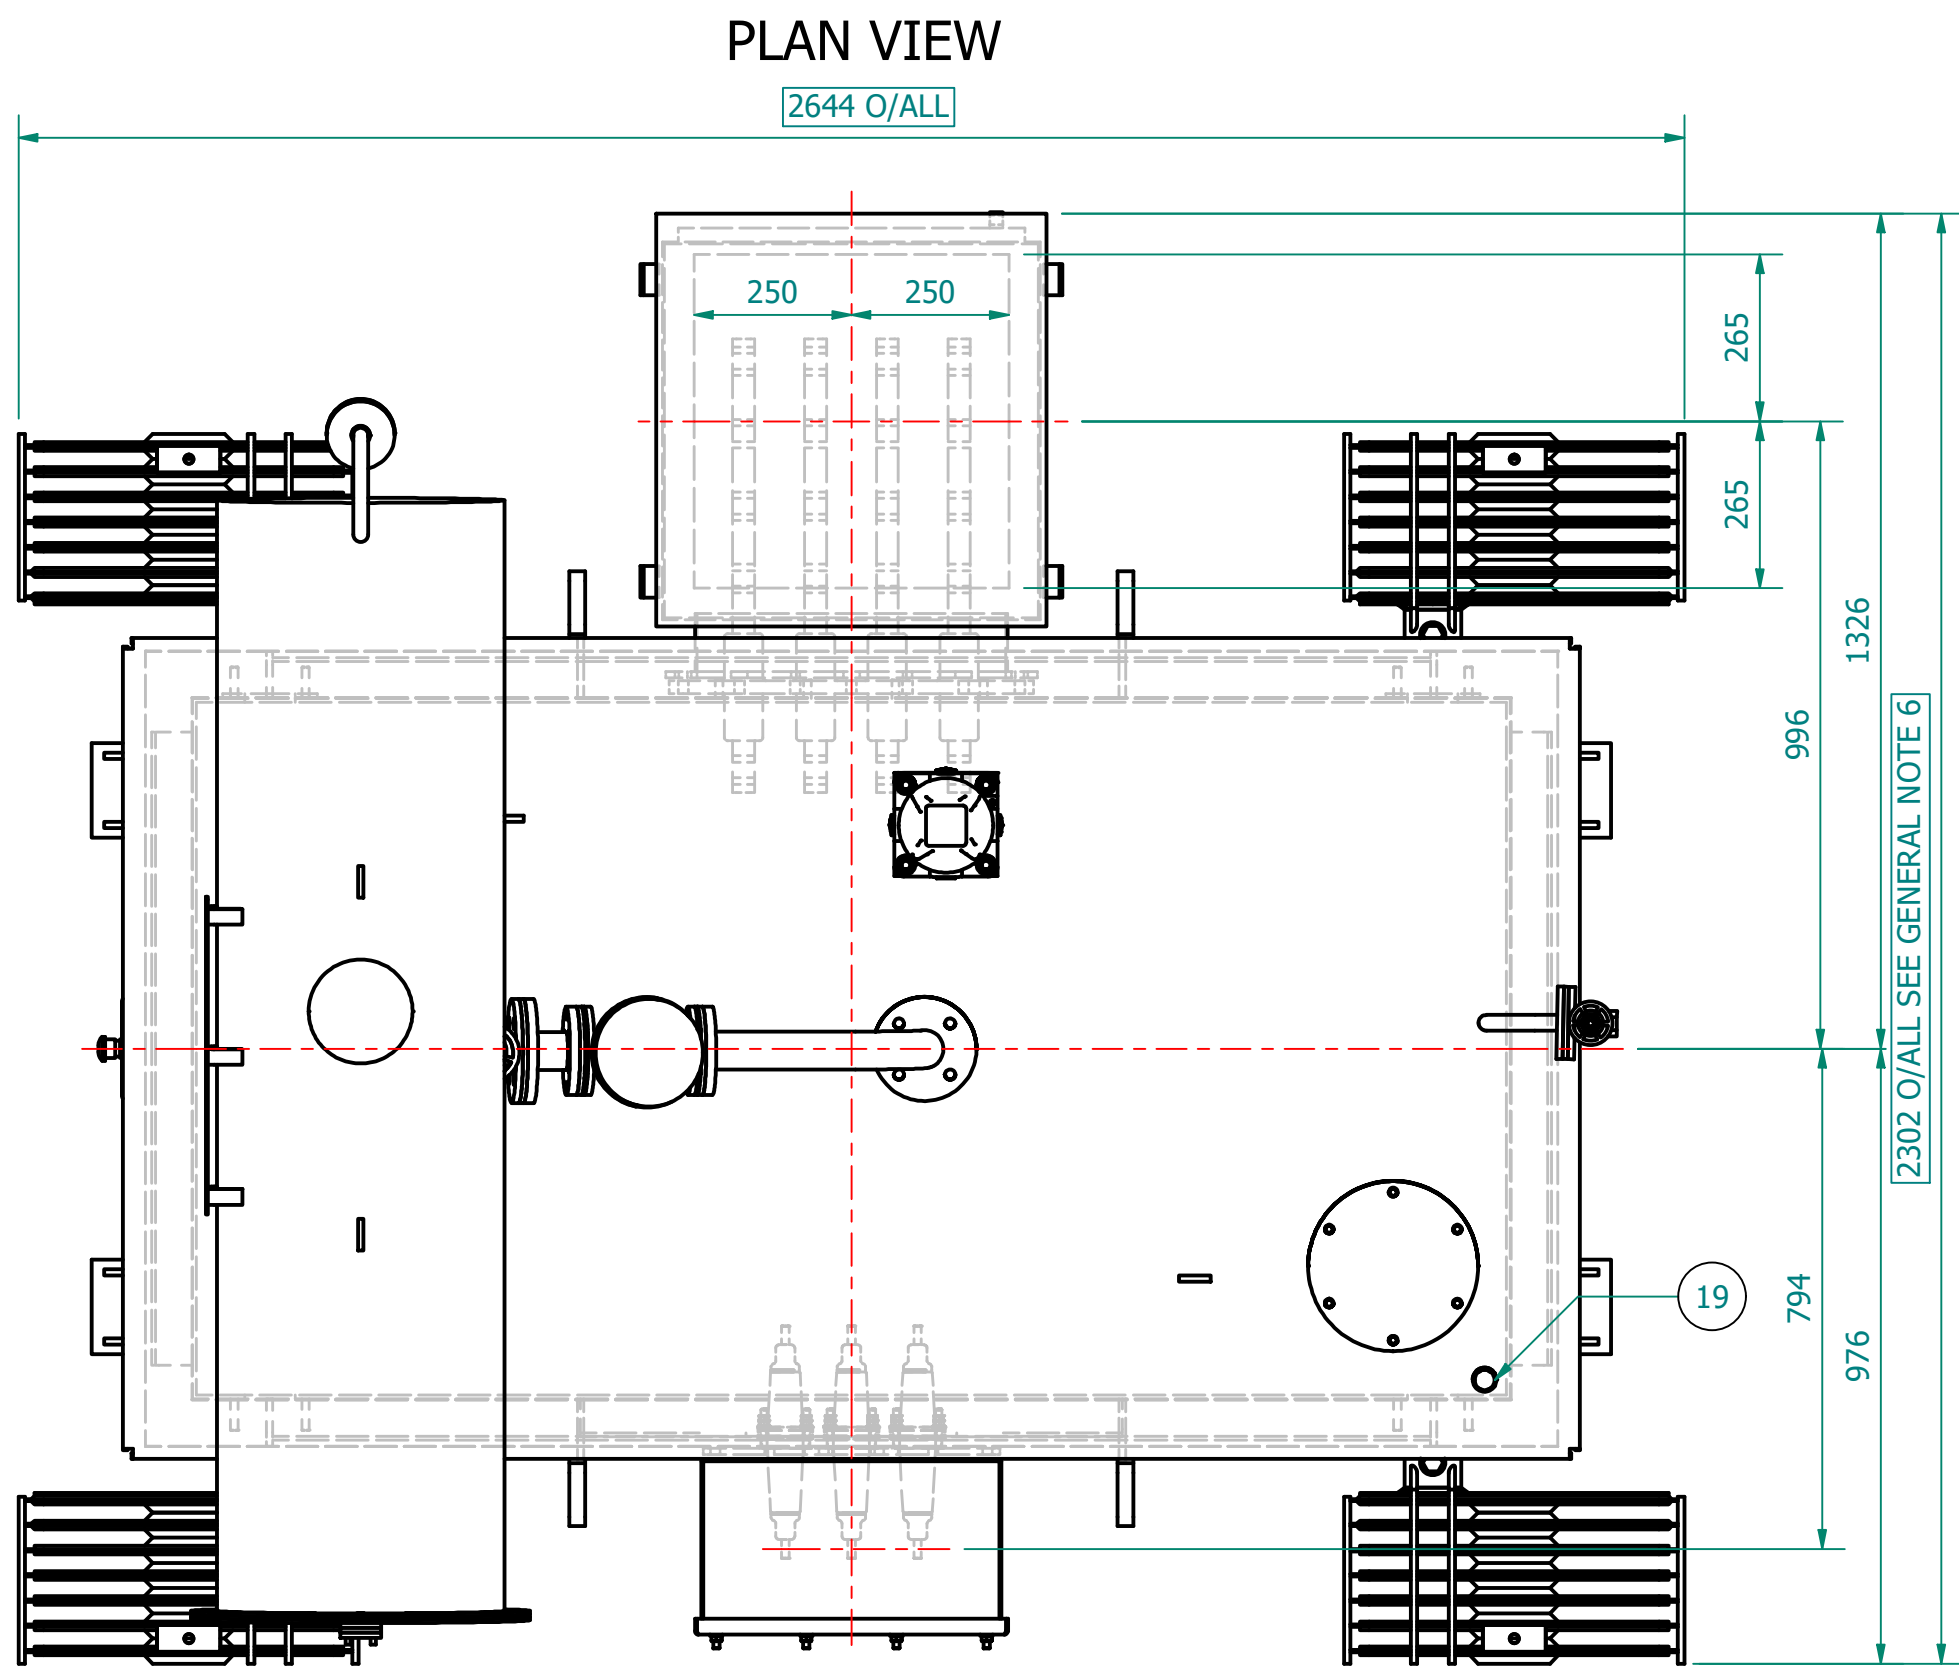
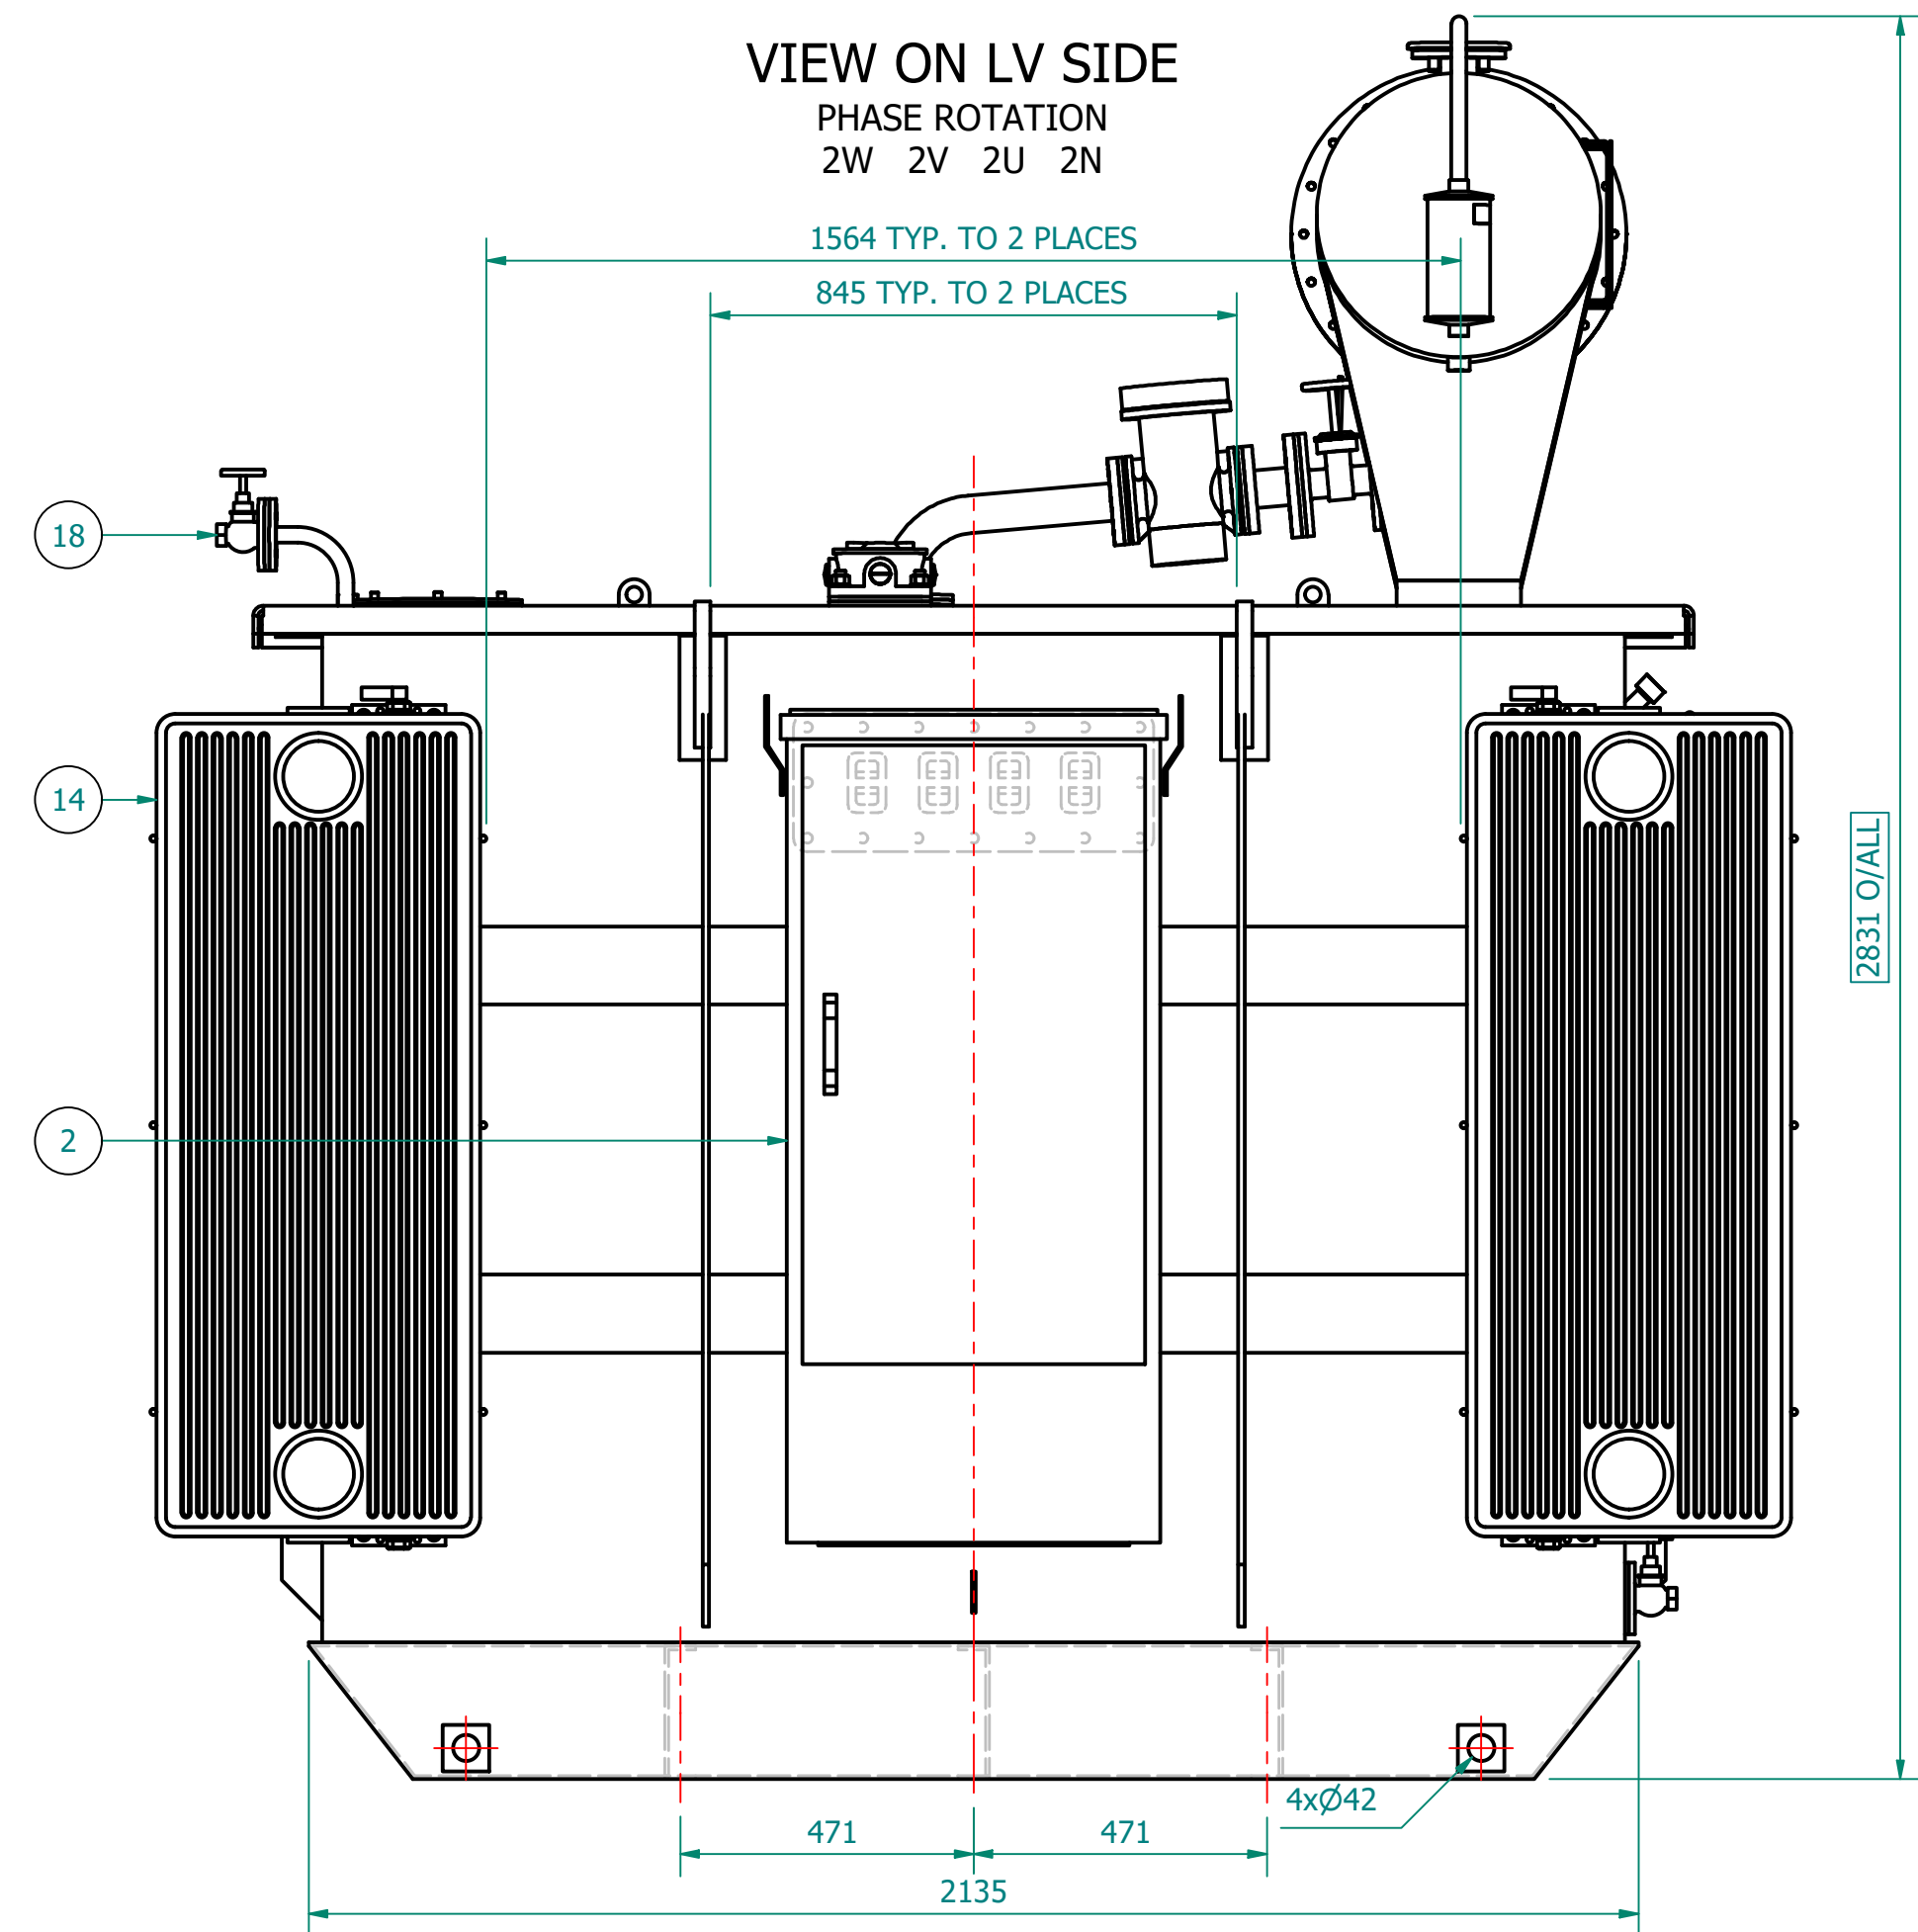


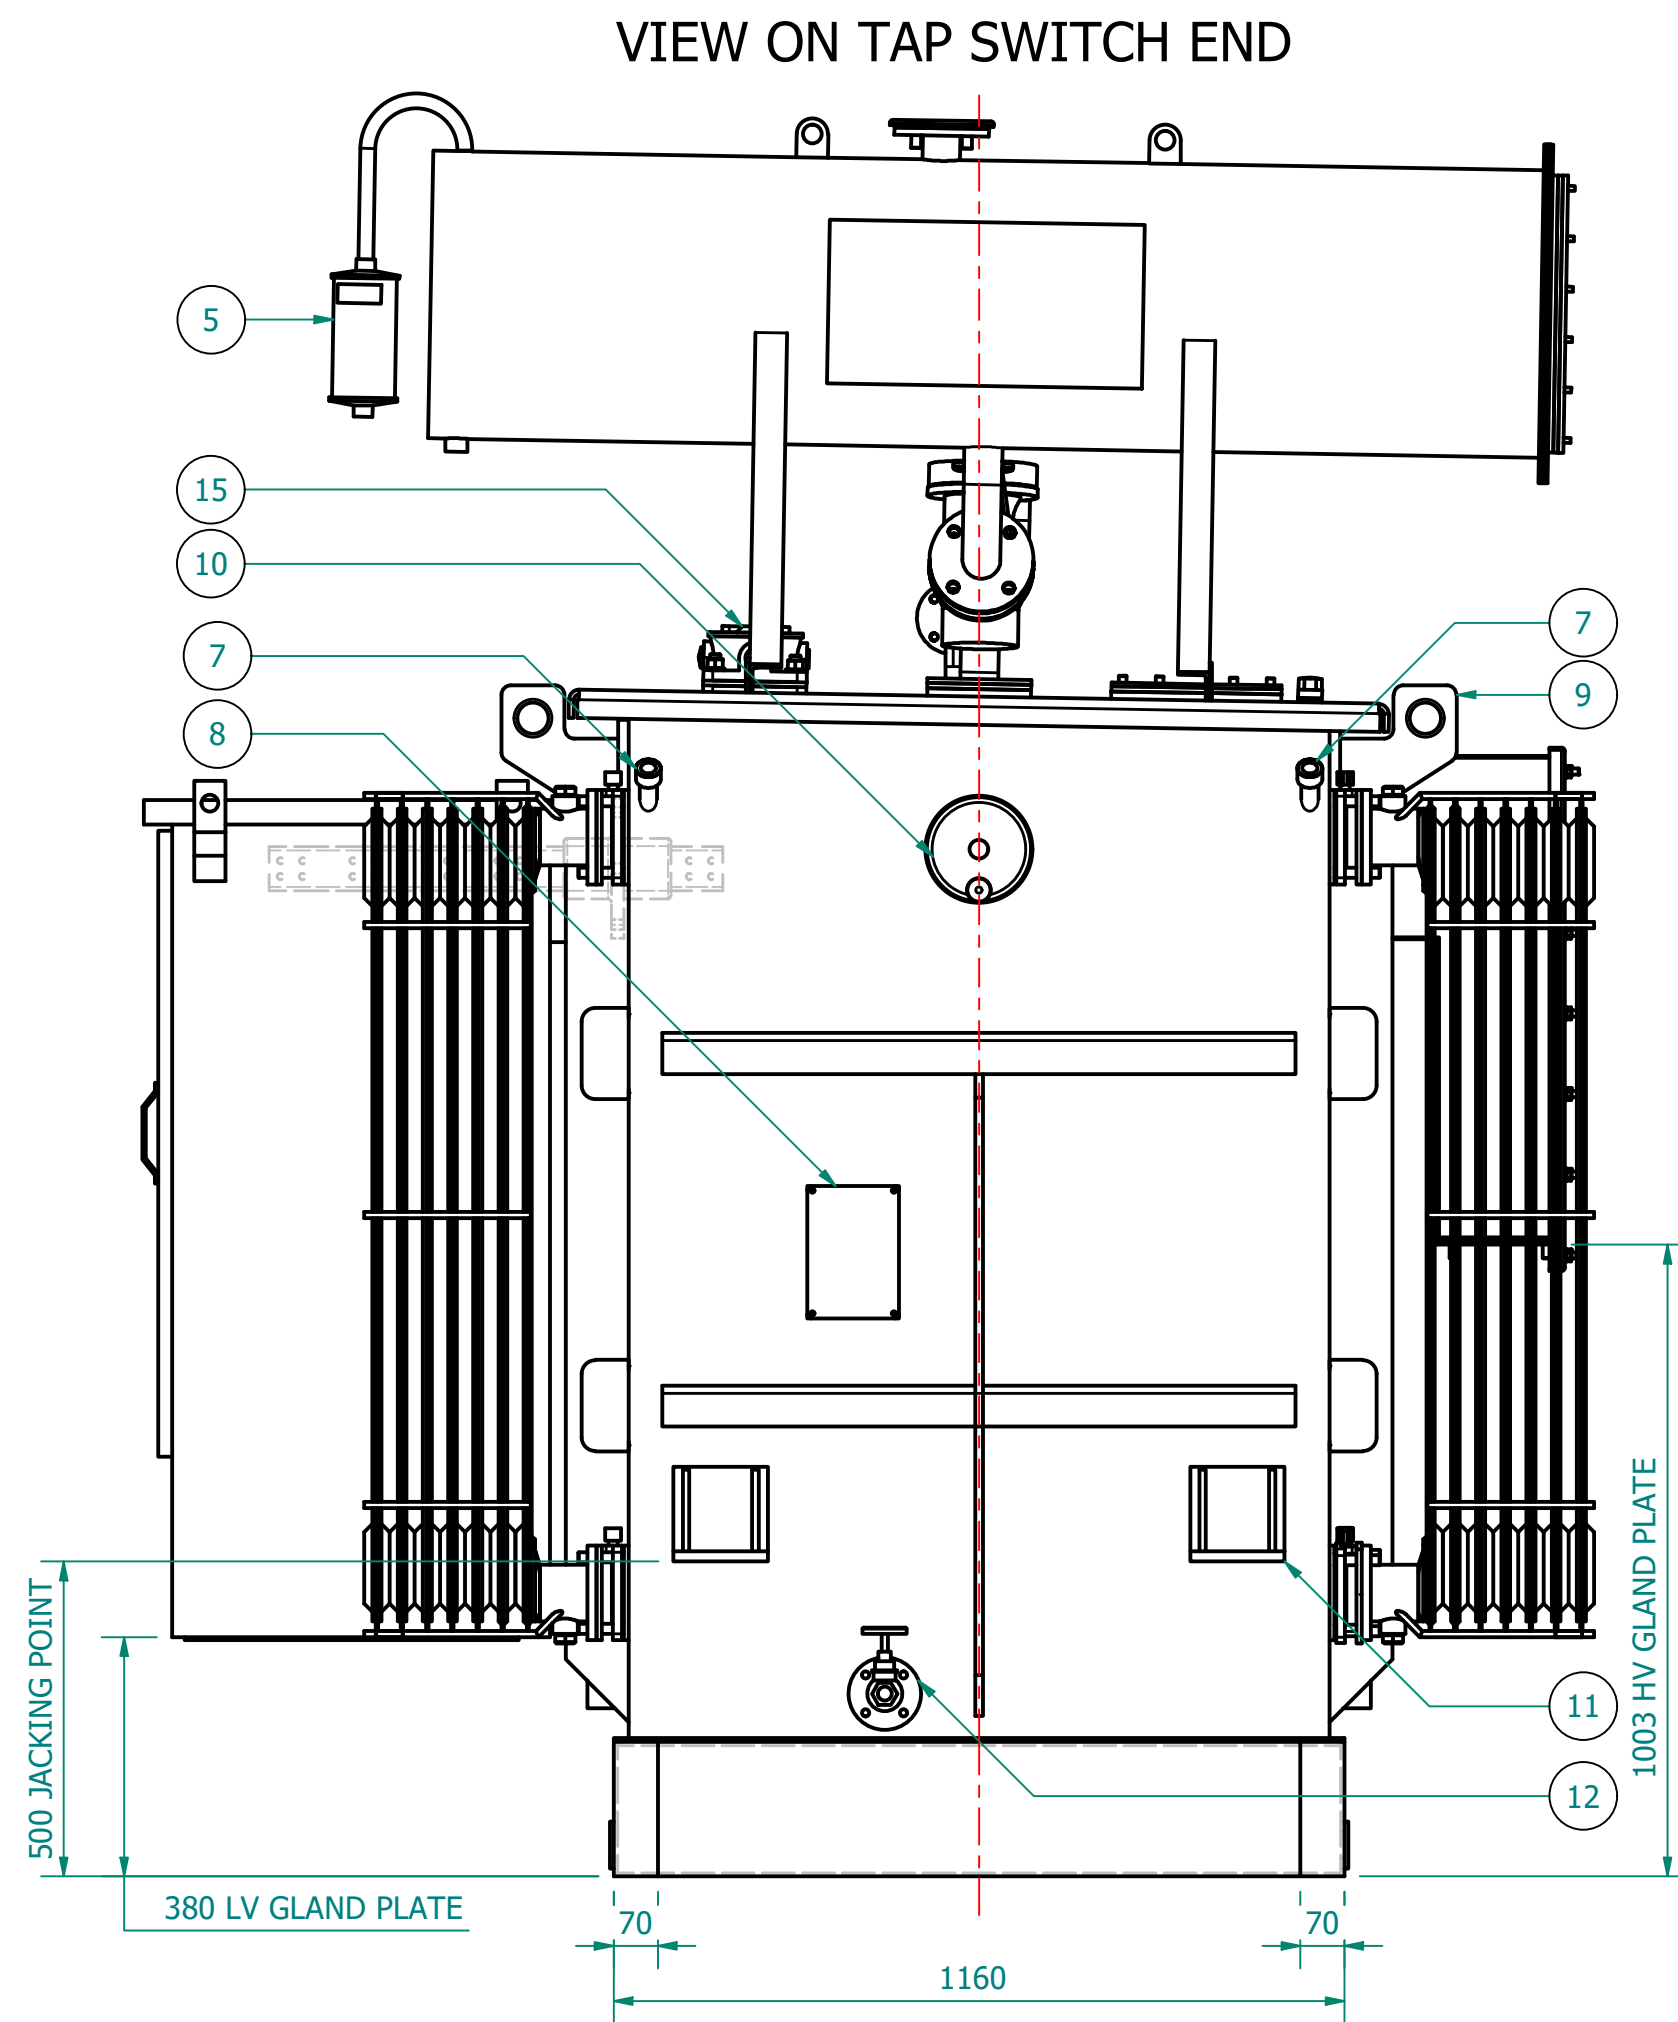


GENERIC LV CABINET SHOWN.
DIMENSIONS WILL CHANGE.
FINAL DESIGN MAY REQUIRE
SUPPORT FRAME.

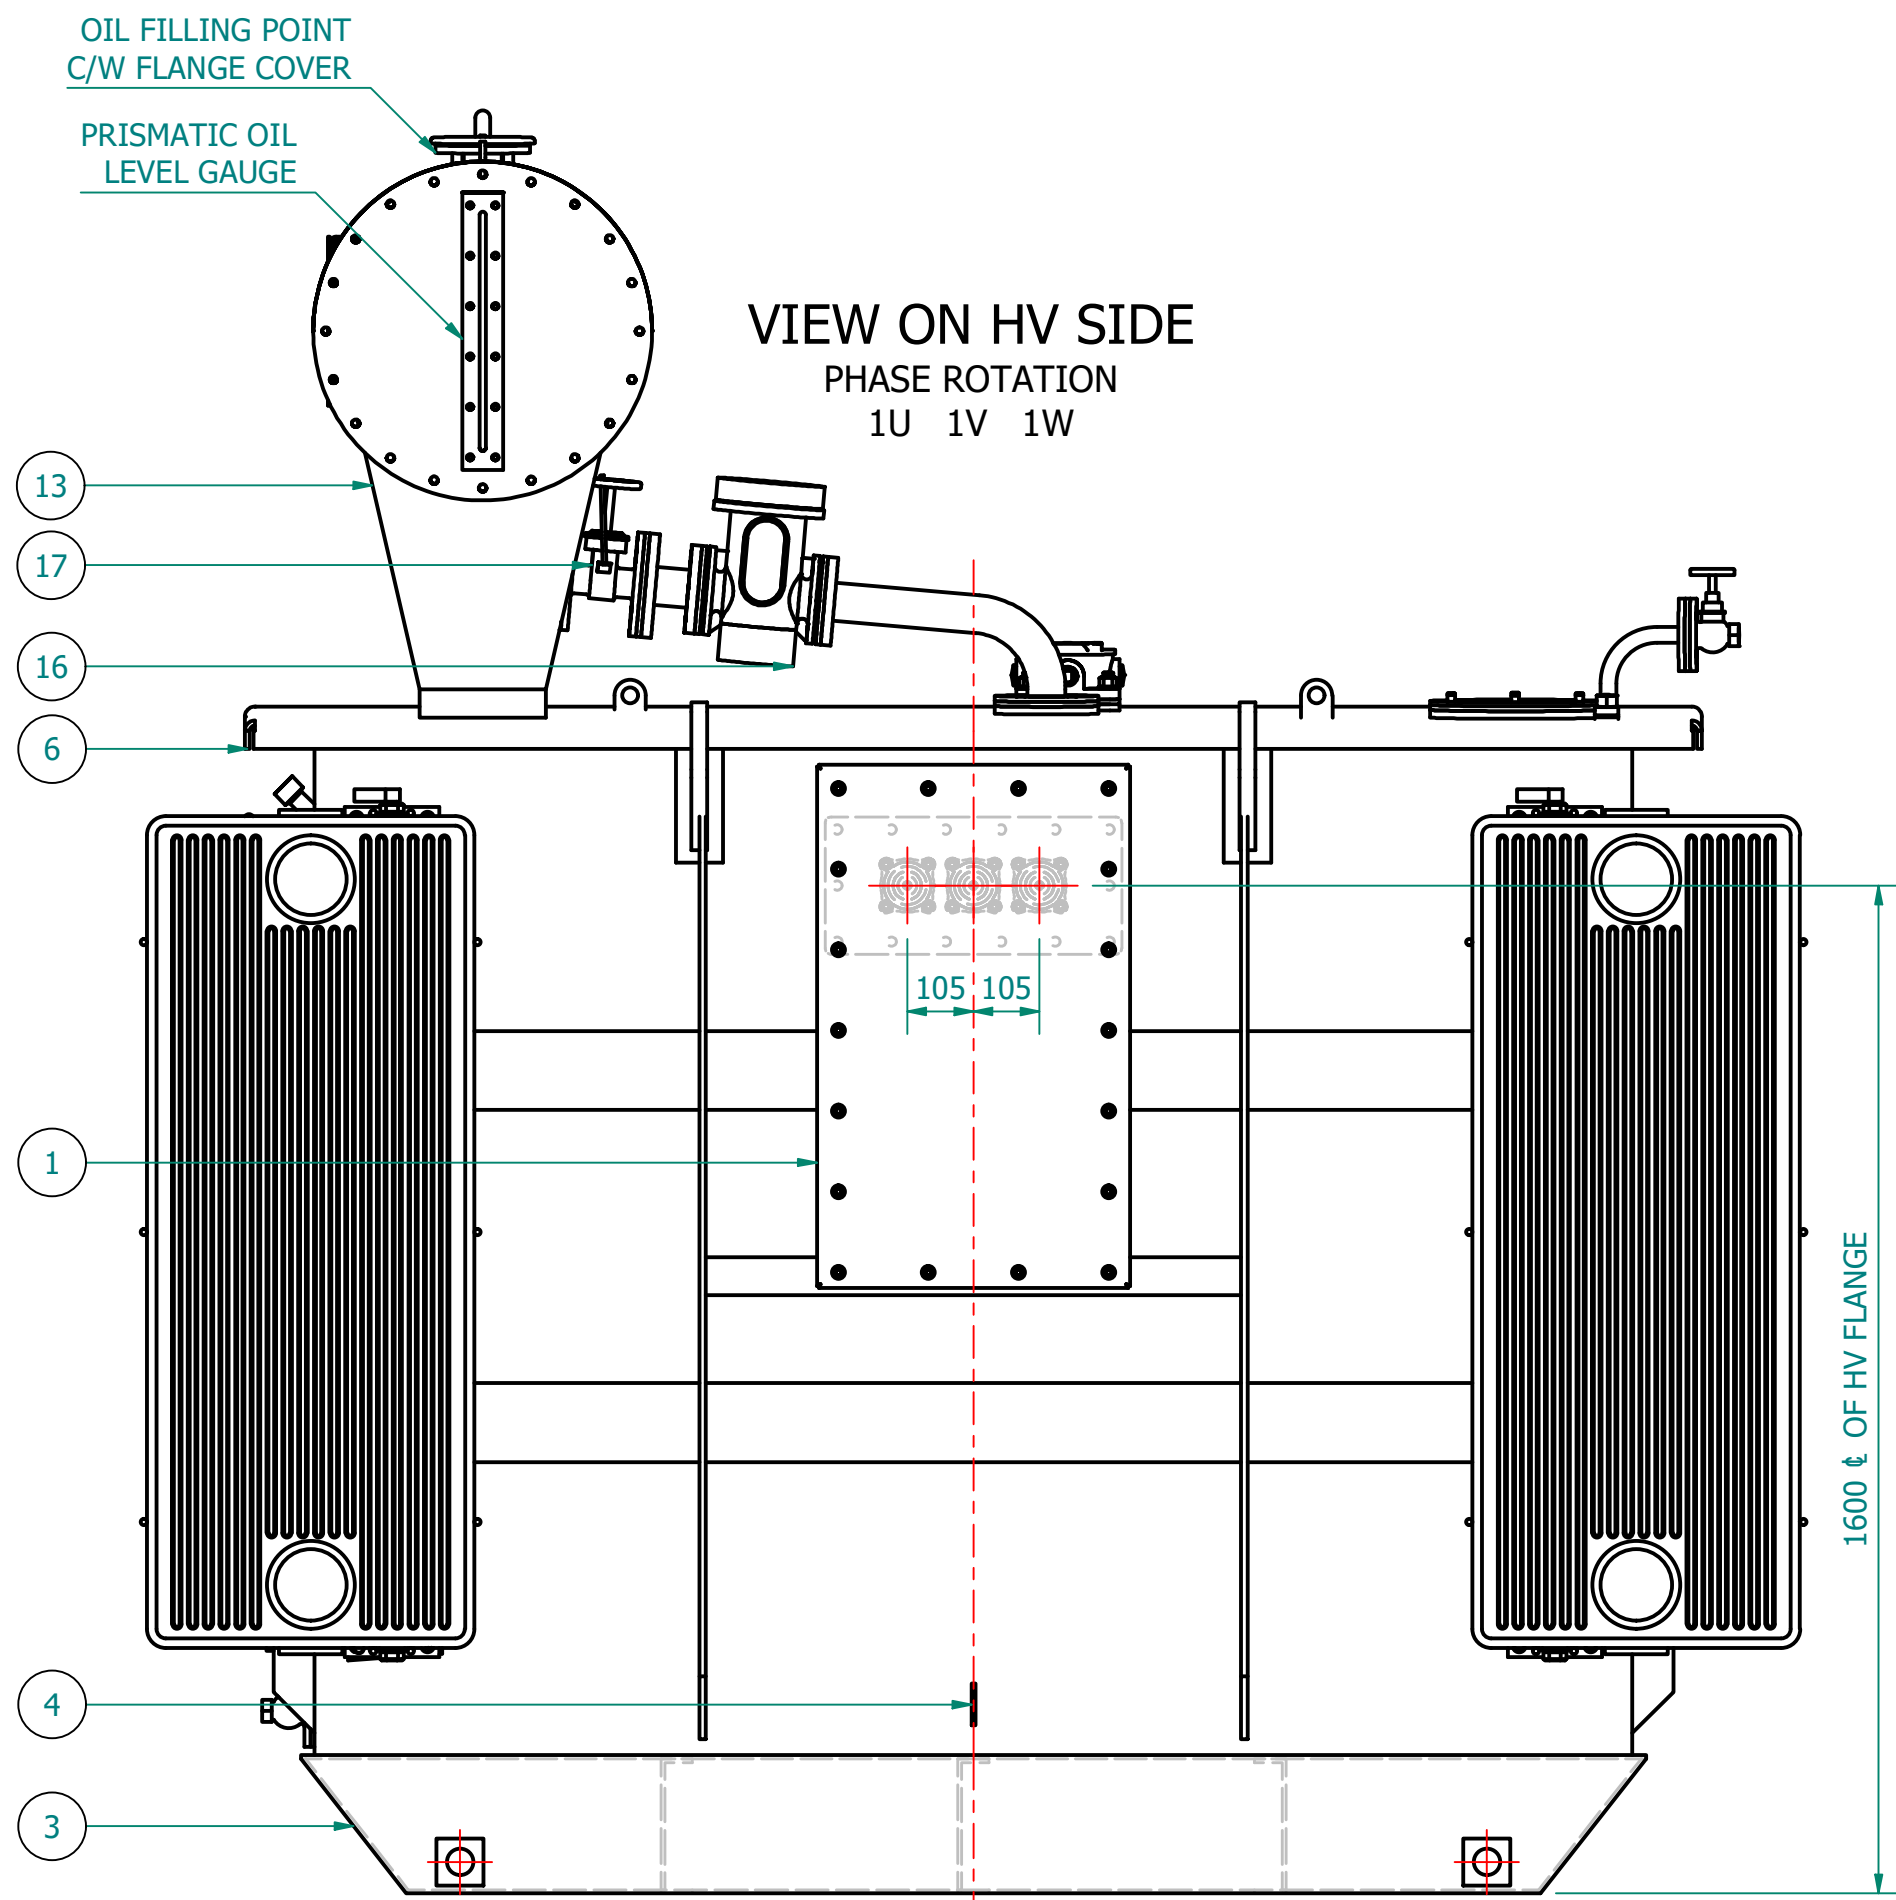



TRANSFORMER WEIGHT & VOLUME		
CORE AND WINDING	kg	5930
TANK AND FITTING	kg	1850
COOLING LIQUID VOLUME	L	2750
COOLING LIQUID WEIGHT	kg	2668
TOTAL TX WEIGHT	kg	10448
ADDITIONS TO THE TRANSFORMER WEIGHT		
LV UNIT	kg	--

VIEW OF LV SIDE - CABLE CLEAT STUDS
CABLES MUST BE SUPPORTED IN ACCORDANCE WITH -
CURRENT IET Wiring Regulations BS7671 & IEC 61914

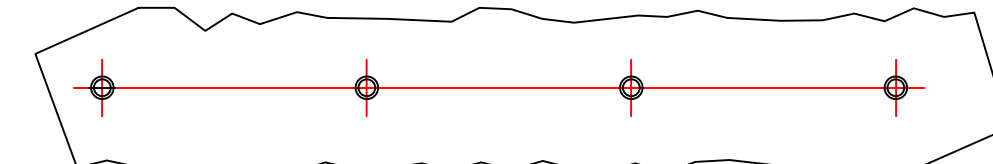

4x M12 x 30 @ 140mm PITCH ~430mm FROM THE GROUND

ESSENTIAL LABELS

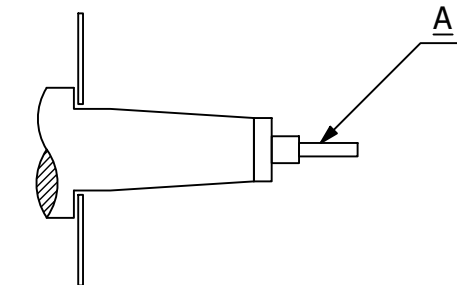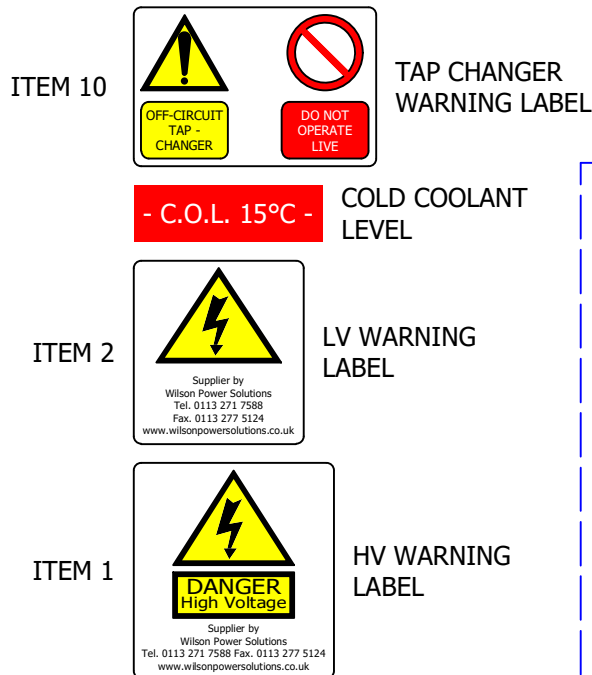


HV TERMINAL DETAILS (01)

0 - 250A	A = M12	20 NM
251 - 400A	A = M16	25 NM

3000kVA			ELECTRICAL RATINGS		
No Load Voltage Ratio at Normal Tap	HV Tappings	Vector Group	Frequency	Full-Load Current at Normal Tap	
				HV Side	LV Side
11000 / 415V	+7.5 to -5.0% IN 2.5% INCREMENTS	Dyn11	50Hz	157.459A	4173.616A
Design Impedance at Normal Tap	No Load Losses at rated Voltage & Frequency	Full Load Losses at rated Current & at 75°C Temp.	Temp. Rise above Ambient 40°C		
			in Oil by Therm.	in Wdg. by Res.	
7.0%	1150W	19000W	60°C	65°C	
GENERAL NOTES					
1	ALL DIMENSIONS ARE IN 'mm'.				
2	ALL DIMENSIONS/WEIGHTS ARE SUBJECT TO ± 10% TOLERANCE.				
3	ELECTRONIC SCALE - 1:1 (ONLY WRITTEN DIMENSIONS TO BE FOLLOWED).				
4	TOLERANCE ON IMPEDANCE PER IEC:60076.				
5	PAINT SHADE.: 632 As PER BS:381C (SEMI GLOSS) TO ISO12944 - MIN C4H SPEC.				
6	O/ALL DIMS ARE SUBJECT EQUIPMENT DOOR OPENING DISTANCES.				
7					
8					
9					

19	1	AIR RELEASE PLUG
18	1	FILTER VALVE (25NB) with MALE PLUG
17	1	SHUT OFF VALVE FOR CONSERVATOR
16	1	BUCHHOLZ RELAY EE2 (WITH ALARM & TRIP CONTACT)
15	1	WTI CT BUSHING TERMINALS ENCLOSED IN BOX
14	4	DETACHABLE RADIATORS with AIR-RELEASE & DRAIN PLUG (520W x 1200C x 75 x 40P)
13	1	DETACHABLE OIL CONSERVATOR W/ PRISMATIC OIL LEVEL GAUGE, OIL FILLING POINT W/ FLANGED COVER & 2 LIFTING LUGS
12	1	DRAIN VALVE (25NB) with MALE PLUG
11	4	JACKING PADS
10	1	OFF-CIRCUIT TAP SWITCH (6-Position & Padlockable)
9	4	TRANSFORMER LIFTING LUGS
8	1	RATING & DIAGRAM PLATE (SS)
7	2	THERMOMETER POCKET (3/4" BSP MALE THREAD)
6	1	TOP COVER with LIFTING LUGS (x2)
5	1	ENVIRO GEL BREATHER TYPE R1
4	2	EARTHING TERMINAL (FLAT TYPE suitable for M12 Bolt)
3	1	TRANSFORMER BASE (SKID TYPE) c/w HAULAGE HOLES & BRACING
2	1	LV CABINET - BOTTOM ENTRY, (FACING-'F', BS:2562), PART NO TBC
1	1	HV CABLE BOX - 12kV, 3-POLE, HEAT-SHRINK INSULATION, (FACING-'F' BS:2562) SUITABLE FOR 1 x 3c CABLE - MAX. 185mm.sq
ITEM	QTY	DESCRIPTION
PARTS LIST		

IF IN DOUBT - **ASK**. REMOVE ALL SHARP EDGES. **DO NOT**
SCALE. DRAWING **NOT TO SCALE**

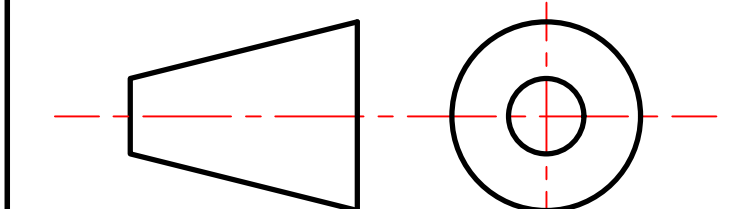

BASED ON:

REVISION HISTORY				DESCRIPTION
REV	REV BY	VERIFIED	APPROVED	

REVISION DESCRIPTION		REV	PROJECT
ORIGINAL			
		00	

REV	DATE	PROJECT
00	24-MAR-2026	

CUSTOMER	S.O. NUMBER	P.O. NUMBER	W.O. NUMBER

DRAWING TITLE	
GENERAL ARRANGEMENT DRAWING FOR 3000kVA WILSON e4 AMORPHOUS ULTIMATE LOW LOSS 11000/415V, 50Hz, Dyn11, KNAN AL WOUND DISTRIBUTION TRANSFORMER LV CABINET	

DRAWN BY:	DATE:	DRAWING NO.:
SATHWIK	24-03-2026	

WILSON POWER SOLUTIONS		Wilson Power Solutions Ltd.	
web: www.wilsonpowersolutions.co.uk email: info@wilsonpowersolutions.co.uk		Westland Square, Leeds, West Yorkshire LS11 5SS, United Kingdom Tel: +44 (0) 113 271 7588 Fax: +44 (0) 113 277 5124	
WPS-E4-3000-AL-A001-KNAN		SHEET 1 OF 1	